
Leuze

Technical data sheet Light curtain receiver Part no.: 50119147 CML730i-R05-1440.R/L-M12

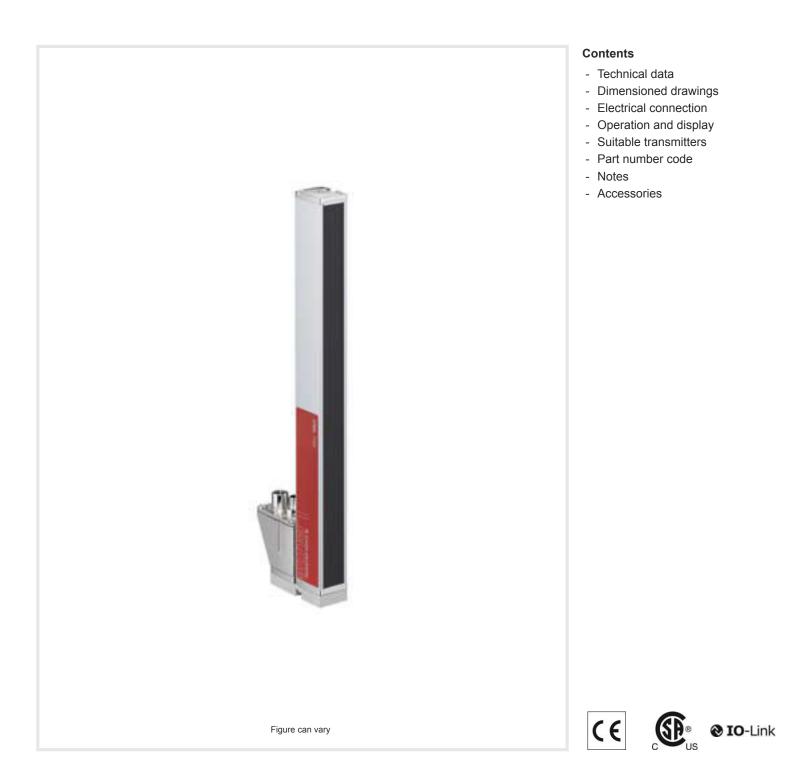

The Sensor People In der Braike 1, 73277 Owen

Leuze electronic GmbH + Co. KG info@leuze.com • www.leuze.com Phone: +49 7021 573-0 • Fax: +49 7021 573-199

Technical data

Leuze

Basic data	
Series	730
Operating principle	Throughbeam principle
Device type	Receiver
Contains	Accessories for the use of the BT-2R1
Application	Detection of transparent objects
	Object measurement
Special version	
Special version	Crossed-beam scanning
	Diagonal-beam scanning
	Parallel-beam scanning
Optical data	
•	
Operating range	Guaranteed operating range
Operating range	0.1 4.5 m
Operating range, transparent media	0.1 1.75 m
Operating range limit	Typical operating range
Operating range limit	0.1 6 m
Measurement field length	1,440 mm
Number of beams	288 Piece(s)
Beam spacing	5 mm
Measurement data	
Minimum object diameter	10 mm
Electrical data	
Protective circuit	Polarity reversal protection
	Short circuit protected
	Transient protection
	· · · · · · · · · · · · · · · · · · ·
Performance data	
Supply voltage U _B	18 30 V, DC
Residual ripple	0 15 %, From U _B
Open-circuit current	0 350 mA, The specified values refer to the entire package consisting of transmitter and receiver.
Inputs/outputs selectable	
Output current, max.	100 mA
Input resistance	6,000 Ω
Number of inputs/outputs selectable	4 Piece(s)
Туре	Inputs/outputs selectable
Voltage type, outputs	DC
Switching voltage, outputs	Typ. U _B / 0 V
Voltage type, inputs	DC
Switching voltage, inputs	high: ≥6V
	low: ≤4V
Input/output 1	0 1 ms
Activation/disable delay	0 1 ms
Timing	
Readiness delay	450 ms
Cycle time	3.03 ms
Response time per beam	10 µs
Interface	
Туре	IO-Link

IO-Link COM mode	COM2
Specification	V1.0.1
opoonioution	V1.1
Min. cycle time	COM2 = 2.3 ms
ervice interface	
	IO-Link
ype	IO-LIIIK
IO-Link	
Function	Configuration via software
	Service
connection	
lumber of connections	2 Piece(s)
Plug outlet	Rear side
C .	
Connection 1	
Function	Configuration interface
	Signal IN
	Signal OUT
	Voltage supply
Type of connection	Connector
Thread size	M12
Туре	Male
Material	Metal
No. of pins	8 -pin
Encoding	A-coded
-	
Connection 2	
Function	Connection to transmitter
Type of connection	Connector
Thread size	M12
Туре	Female
Material	Metal
No. of pins	5 -pin
Encoding	A-coded
lechanical data	
lesign	Cubic
Dimension (W x H x L)	29 mm x 35.4 mm x 1,463 mm
lousing material	Metal
letal housing	Aluminum
ens cover material	Plastic
let weight	1,650 g
lousing color	Silver
ype of fastening	Groove mounting
	Via optional mounting device
)peration and display	
	LED
ype of display	OLED display
ype of display	OLED display 2 Piece(s)
Type of display	OLED display 2 Piece(s) Software
Type of display Number of LEDs Type of configuration	OLED display 2 Piece(s) Software Teach-in
Type of display Number of LEDs Type of configuration	OLED display 2 Piece(s) Software
Operation and display Type of display Number of LEDs Type of configuration Operational controls	OLED display 2 Piece(s) Software Teach-in
ype of display lumber of LEDs ype of configuration Operational controls	OLED display 2 Piece(s) Software Teach-in

Leuze electronic GmbH + Co. KG info@leuze.com • www.leuze.com

Technical data

Leuze

Certifications


IP 65
III
c CSA US
IEC 60947-5-2
0

Classification

90314990
27270910
27270910
27270910
27270910
27270910
EC002549
EC002549
EC002549

Dimensioned drawings

All dimensions in millimeters

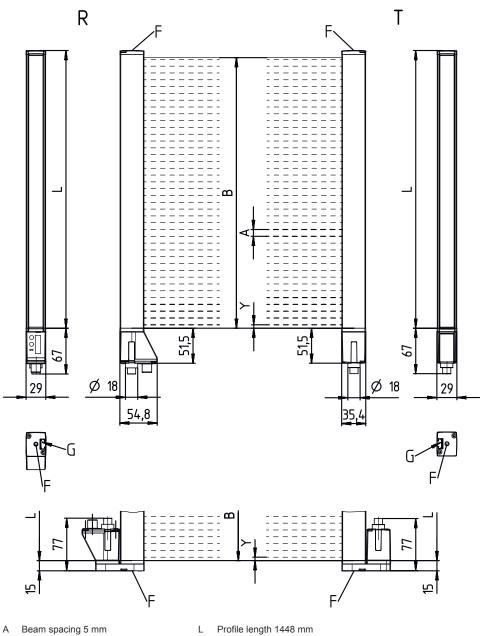


- Beam spacing 5 mm А
- В Measurement field length 1440 mm
- F M6 thread G Fastening groove
- Т R Receiver
 - 2.5 mm Υ

Transmitter

Leuze

Dimensioned drawings



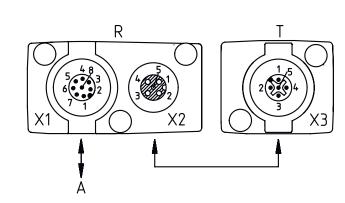

A PWR / SW IN / OUT

Electrical connection

Connection 1

Function	Configuration interface
	Signal IN
	Signal OUT
	Voltage supply
Type of connection	Connector
Thread size	M12
Туре	Male
Material	Metal
No. of pins	8 -pin
Encoding	A-coded

Pin Pin assignment

1 V+
I V+
2 IO1
3 GND
4 IO-Link
5 IO2
6 IO3
7 104
8 GND



Connection 2

Connection to transmitter
Connector
M12
Female
Metal
5 -pin
A-coded

Pin Pin assignment

1	FE/SHIELD
2	V+
3	GND
4	RS 485 Tx+
5	RS 485 Tx-



Operation and display

-		
LED	Display	Meaning
1	Green, continuous light	Operational readiness
	Green, flashing	Teach / error
2	Yellow, continuous light	Light path free, with function reserve
	Yellow, flashing	No function reserve
	Off	Object detected

Suitable transmitters

Part no.	Designation	Article	Description
50118929	CML730i-T05-	Light curtain	Operating range: 0.1 4 m
	1440.R-M12	transmitter	Connection: Connector, M12, Rear side, 5 -pin

Part number code

Part designation: CML7XXi-YZZ-AAAA.BCCCDDD-EEEFFF

CML	Operating principle Measuring light curtain
7XXi	Series 720i: 720i series 730i: 730i series
Y	Device type T: transmitter R: receiver
ZZ	Beam spacing 05: 5 mm 10: 10 mm 20: 20 mm 40: 40 mm
AAAA	Measurement field length [mm], dependent on beam spacing
В	Equipment A: connector outlet, axial R: rear connector outlet
ccc	Interface L: IO-Link /CN: CANopen /PB: PROFIBUS /PN: PROFINET /CV: Analog current and voltage output /D3: RS 485 Modbus
DDD	Special equipment -PS: Power Setting
EEE	Electrical connection M12: M12 connector
FFF	-EX: Explosion protection
Note	
A list wi	th all available device types can be found on the Leuze website at www.leuze.com.

Leuze

Notes



Observe intended use!

✤ This product is not a safety sensor and is not intended as personnel protection.

 $\ensuremath{^{\ensuremath{\Downarrow}}}$ The product may only be put into operation by competent persons.

	For UL applications:
A	 For UL applications, use is only permitted in Class 2 circuits in accordance with the NEC (National Electric Code). These proximity switches shall be used with UL Listed Cable assemblies rated 30V, 0.5A min, in the field installation, or equivalent (categories: CYJV/ CYJV7 or PVVA/PVVA7)

Accessories

Connection technology - Connection cables

 Part no.	Designation	Article	Description
50135128	KD S-M12-8A-P1-050	Connection cable	Connection 1: Connector, M12, Axial, Female, A-coded, 8 -pin Connection 2: Open end Shielded: Yes Cable length: 5,000 mm Sheathing material: PUR

Connection technology - Interconnection cables

	Part no.	Designation	Article	Description
	50129781	KDS DN-M12-5A- M12-5A-P3-050	Interconnection cable	Suitable for interface: IO-Link, DeviceNet, CANopen Connection 1: Connector, M12, Axial, Female, A-coded, 5 -pin Connection 2: Connector, M12, Axial, Male, A-coded, 5 -pin Shielded: Yes Cable length: 5,000 mm Sheathing material: PUR

Mounting technology - Mounting brackets

	Part no.	Designation	Article	Description
1.1	50142900	BT 700M.5-2SET	Mounting device set	Design of mounting device: Bracket mounting Fastening, at system: Through-hole mounting, T slotted hole Mounting bracket, at device: Screw type, Sliding block Type of mounting device: Rigid Material: Steel

Leuze

Accessories



Mounting technology - Swivel mounts

	Part no.	Designation	Article	Description
ęę.	429046	BT-2R1	Mounting bracket set	Fastening, at system: Through-hole mounting Mounting bracket, at device: Clampable Type of mounting device: Turning, 360° Material: Metal, Plastic

Configuration devices

 Part no.	Designation	Article	Description
50121098	SET MD12-US2-IL1.1 + Zub.	Diagnostics set	Interface: USB Connections: 2 Piece(s) Degree of protection: IP 20

Services

 Part no.	Designation	Article	Description
S981001	CS10-S-110	Start-up support	Details: Performed at location of customer's choosing, duration: max. 10 hours. Conditions: Devices and connection cables are already mounted, price not including travel costs and, if applicable, accommodation expenses. Restrictions: No mechanical (mounting) and electrical (wiring) work performed, no changes (attachments, wiring, programming) to third-party components in the nearby environment.
S981005	CS10-T-110	Product training	Details: Location and content to be agreed upon, duration: max. 10 hours. Conditions: Price not including travel costs and, if applicable, accommodation expenses. Restrictions: Travel costs and accommodation expenses charged separately and according to expenditure.

Note

& A list with all available accessories can be found on the Leuze website in the Download tab of the article detailed page.